



www.sihga.com

Monitorix® LAN-module

INNOVATIVE CONSTRUCTION TECHNOLOGY
AND SUPPORT FOR THE FUTURE

MA Nr. 60309/24/10/EN

TAKE THE BEST




Assembly video



SIHGA® GmbH | Gewerbepark Kleinreith 4 | 4694 Ohlsdorf bei Gmunden | AUSTRIA
Tel.: +43 7612 / 74 370 - 0 | E-Mail: info@sihga.com | www.sihga.com

1

Packaging unit: 1 pc
Top-hat rail mounting possible
On top hat rail: 2 DU*

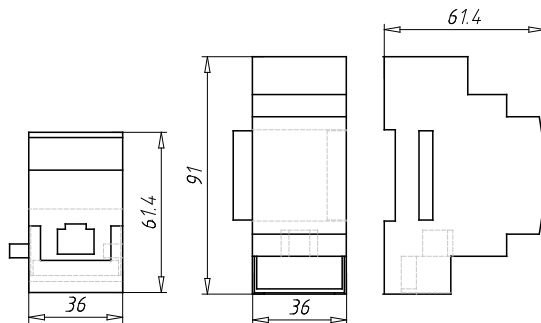

*DU= Dividing unit (18 mm)


2

Network requirements:


- LAN connection via RJ45 cable 10/100 Mbps to a router a router (no POE).
- DHCP server must provide IP address.
- DHCP must also provide valid DNS.
- Network connection must not require a proxy.
- Required outgoing ports in Internet:
80 TCP, 443 TCP, 53 UDP/TCP,
123 UDP/TCP, ICMP
- Incoming connections are not carried out -
No NAT forwarding necessary

3 Tool-free assembly:

- 01 Plug connection (female) for connector
- 02 Plug connection (male) to processor unit
- 03 Plug connection for network (LAN cable)

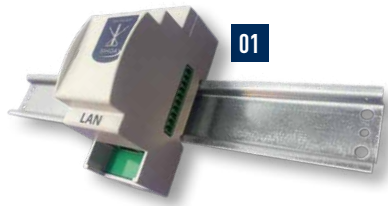

4 Connection:

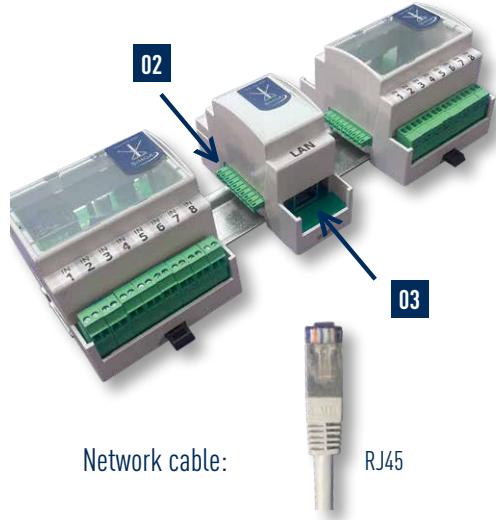

5 Connection to electronics:

power supply processor unit LAN-module



6 LAN-status-LED:

LED lights up or flashes when connected to router/network

